


NOTES:

- 1 INLET
- 2 OUTLET
- 3 PIPE TO MANHOLE CONNECTION, IF REQUIRED
- 4 DOUBLE CHECK VALVE BACKFLOW ASSEMBLY
- 5 27" MANHOLE RING AND LID
- 6 4' DIA. CONCRETE PRECAST ECCENTRIC MANHOLE CONE
DESIGN BY OTHERS

- A CLEAR DISTANCE, 12" MINIMUM
- B CLEAR DISTANCE, 18" MINIMUM

OPTIONS FOR INLET AND OUTLET INSTALLATION

- A CORE DRILL MANHOLE AND USE FLEXIBLE GASKET FOR PIPE TO MANHOLE CONNECTION
- B INSTALL PIPE A MINIMUM OF 6" BELOW WALL AND USE FITTINGS INTO MANHOLE

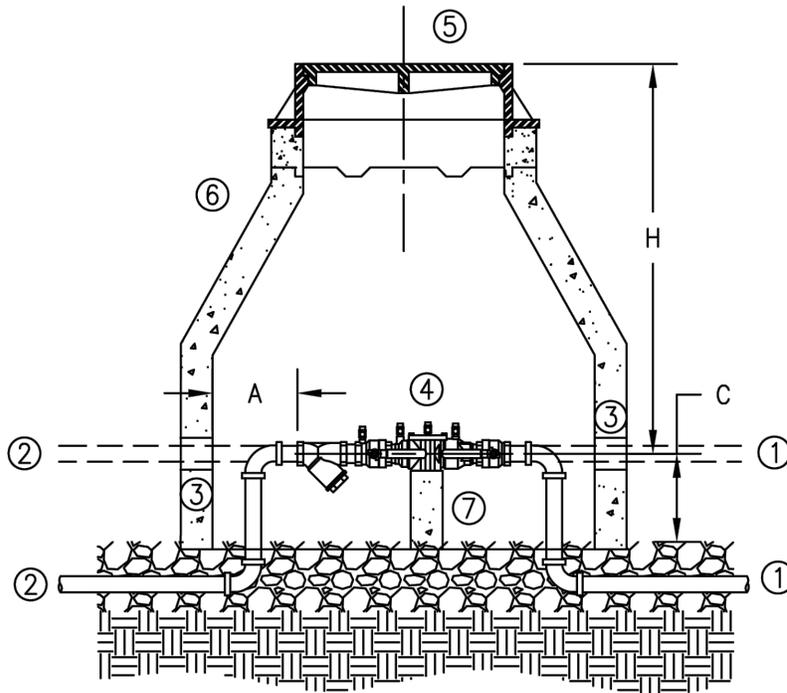

SECTION A-A


NOTES:

- 1 INLET
- 2 OUTLET
- 3 PIPE TO MANHOLE CONNECTION, IF REQUIRED
- 4 DOUBLE CHECK VALVE BACKFLOW ASSEMBLY
- 5 27" MANHOLE RING AND LID
- 6 4' DIA. CONCRETE PRECAST ECCENTRIC MANHOLE CONE
DESIGN BY OTHERS
- 7 CONCRETE PIPE SUPPORT, IF REQUIRED

- A CLEAR DISTANCE, 12" MINIMUM
- C CLEAR DISTANCE, 12" MINIMUM
- H 42" MINIMUM

OPTIONS FOR INLET AND OUTLET INSTALLATION

- A CORE DRILL MANHOLE AND USE FLEXIBLE GASKET FOR PIPE TO MANHOLE CONNECTION
- B INSTALL PIPE A MINIMUM OF 6" BELOW WALL AND USE FITTINGS INTO MANHOLE

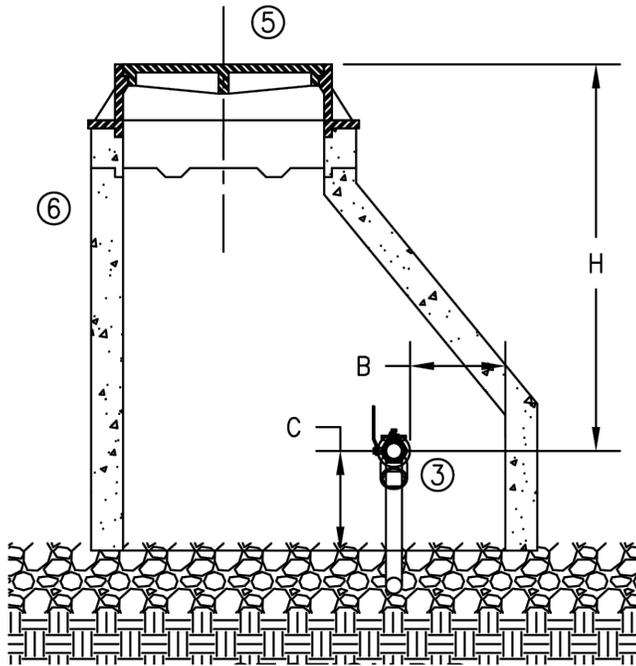

SECTION B-B

NOTES:

- | | | | |
|---|---|---|-----------------------------|
| 3 | PIPE TO MANHOLE CONNECTION, IF REQUIRED | B | CLEAR DISTANCE, 18" MINIMUM |
| 5 | 27" MANHOLE RING AND LID | C | CLEAR DISTANCE, 12" MINIMUM |
| 6 | 4' DIA. CONCRETE PRECAST ECCENTRIC MANHOLE CONE
DESIGN BY OTHERS | H | 42" MINIMUM |

OPTIONS FOR INLET AND OUTLET INSTALLATION

- A CORE DRILL MANHOLE AND USE FLEXIBLE GASKET FOR PIPE TO MANHOLE CONNECTION
- B INSTALL PIPE A MINIMUM OF 6" BELOW WALL AND USE FITTINGS INTO MANHOLE